



1000989284 Ontario Inc. c/o R.W. Tomlinson Limited
**VL – Elmwood Drive
Water Supply Report**

Prepared by:

FOREFRONT Engineering Inc.
1329 Gardiners Road, Suite 210
Kingston, ON, Canada K7P 0L8

613.634.9009 tel

Date: May 2026

Statement of Qualifications and Limitations

The attached Report has been prepared by Forefront Engineering Inc. (Consultant) for the benefit of the Client in accordance with their Agreement.

The information, data, recommendations and conclusions contained in the Report:

1. is subject to the scope, schedule, and other constraints and limitations in the Agreement and the qualifications contained in the Report;
2. represents Consultant's judgement in light of the limitations and industry standards for the preparation of similar reports;
3. may be based on information provided to Consultant which has not been independently verified;
4. has not been updated since the date of issuance of the Report and its accuracy is limited to the time and circumstances in which it was prepared; and
5. must be read as a whole and sections should not be read out of context.

Consultant shall be entitled to rely upon the accuracy and completeness of information that was provided to it and has no obligation to update such information. Consultant accepts no responsibility for any events or circumstances that may have occurred since the date on which the Report was prepared.

Any estimates or opinions regarding expected construction costs or construction schedule provided by Consultant represent Consultant's judgement in light of its experience and the knowledge and information available to it at the time of preparation. Consultant does not make any representations, with respect to such estimates or opinions, and accepts no responsibility for any loss or damage arising from them. Persons relying on such estimates or opinions do so at their own risk.

Except as agreed to in writing by Consultant and Client; as required by law; or to the extent used by governmental reviewing agencies for the purpose of obtaining permits or approvals, the Report and the Information may be used and relied upon only by Client.

Consultant accepts no responsibility to parties other than Client who may obtain access to the Report or the information for any injury, loss or damage suffered by such parties arising from their use of, reliance upon, or decisions or actions based on the Report, except to the extent those parties have obtained the prior written consent of Consultant to use and rely upon the Report and the information. Any injury, loss or damages arising from improper use of the Report shall be borne by the party making such use.

May 27, 2026

1000989284 Ontario Inc
c/o R.W. Tomlinson Limited
Jennifer Ailey, Land Development Manager
100 CitiGate Drive
Nepean ON K2J 6K7

**Regarding: VL – Elmwood Drive
 Water Supply Report**

Dear Ms. Ailey,

The enclosed report details the existing water infrastructure and our recommendations for water services for the proposed Elmwood Subdivision located in the Town of Gananoque.

The proposed VL – Elmwood Drive Subdivision is located in the east end of Gananoque, south of Elizabeth Drive, Churchill Drive, and Arthur Street, and north of the St. Lawrence River. The site is approximately 11.59 ha. and consists of approximately 66 single-detached units, 23 townhouse units and 14 cluster townhouse units for a total of 103 units. The development will include the extension of Elmwood Drive, John Street, Arthur Street, two new streets, and proposed parkland.

It is recommended that a 200 mm watermain be installed along the proposed streets with connections to the existing 300 mm diameter watermain on Elmwood Drive and Arthur Street, and the existing 150mm diameter watermain on John Street.

Preliminary calculations demonstrate that the existing water infrastructure is capable of supplying adequate fire flow and pressure to the proposed development.

This Report demonstrates that adequate water servicing is available for the proposed development.

If you have any enquiries or wish to discuss further, please contact this office.

Sincerely,

FOREFRONT Engineering Inc.



Jeff Homer, P.Eng.
Jeff.Homer@Forefronteng.ca

FOREFRONT Signatures

Report Prepared By:

Jeff Homer, P.Eng.



Report Reviewed By:

Kyle Nielissen, P.Eng.



Table of Contents

Statement of Qualifications and Limitations Letter of Transmittal

	Page
1. Introduction	1
2. Water Supply	2
2.1 Existing Conditions	2
2.2 Proposed Development	2
3. Conclusions	4

Appendices

Appendix A.

- Concept Plan
- Figure 2 – Proposed Water Infrastructure

Appendix B.

- Hydrant Flow Data Table
- Proposed Distribution Demands
- EPA NET – Modelling Results
 - Water Distribution Schematic
 - Proposed Maximum Day Plus Fire Flow – Water Model Results
 - Proposed Peak Hour Flow – Water Model Results

1. Introduction

Forefront has assembled relevant supporting information for the proposed residential subdivision at Part of Lot 16, Concession 1 in the Town of Gananoque in the County of Leeds.

The proposed VL – Elmwood Drive Subdivision is located in the Town of Gananoque north of the St. Lawrence River, east of William Street South, and south of Arthur Street. The land to the east is undeveloped, zoned Residential and identified as Significant Woodlands in the Official Plan. The property is bounded by existing residential dwellings to the north and west. Refer to Figure 1: Site Location for reference.



Figure 1: Site Location

The subject site is currently zoned Residential within the Town of Gananoque. The property is currently vacant with no existing structures.

The proposed VL – Elmwood Drive Subdivision is approximately 11.59 ha. and consists of approximately 66 single-detached units, 23 townhouse units and 14 cluster townhouse units for a total of 103 units. The subdivision will include the extension of Elmwood Drive, John Street, Arthur Street two new streets, and proposed parkland.

It is recommended that water services be installed along the proposed streets with connections to Elmwood Drive, Arthur Street and John Street.

Development of the VL – Elmwood Drive Subdivision will result in an increase in municipal water consumption. This Water Supply Report proposes a plan to provide water services for the proposed subdivision.

Refer to **Appendix A, Concept Plan** for the proposed subdivision plan.

2. Water Supply

2.1 Existing Conditions

The Town of Gananoque's Water Treatment Plant (WTP), located at 110 Kate Street, supplies potable water to the Charles Street North Elevated Storage Tank (EST) and the Town of Gananoque's water distribution system.

Existing 300 mm diameter watermain are located on Elmwood Drive and Arthur Street and an existing 150 mm diameter watermain is located on John Street.

2.2 Proposed Development

The proposed VL – Elmwood Drive Subdivision is approximately 11.59 ha. and consists of approximately 66 single-detached units, 23 townhouse units and 14 cluster townhouse units for a total of 103 units. The subdivision will include the extension of Elmwood Drive, John Street, Arthur Street two new streets, and proposed parkland.

A 200 mm diameter watermain and connections to the 300mm diameter watermain on Elmwood Drive and Arthur Street, and the existing 150 mm diameter watermain on John Street are proposed. 50mm watermain looping are proposed in both cul-de-sacs to avoid stagnant dead-end sections. Fire hydrants are proposed at 150 m spacing throughout the subdivision.

25 mm cross-linked high-density polyethylene (PEX) services are proposed throughout.

Please refer to **Appendix A: Figure 2: Proposed Water Infrastructure** for further details.

Development of the VL – Elmwood Drive Subdivision will result in an increase in municipal water consumption.

The Town of Gananoque's Public Works Utilities Division and the Ministry of the Environment, Conservation and Parks (MECP) require that the system be assessed at the critical locations for peak hour flow, maximum day, and maximum day plus fire flow demand. MECP requires that the system maintain an operating pressure of 280-700 kPa under peak flow conditions and 140 kPa under maximum day plus fire flow conditions.

Design Flow Parameters

Average Residential Flow	350 L/cap/day
Maximum Day Factor	2.75
Peak Hour Factor	4.25

Population Density

Single Family	4.00 people/unit
Townhouse / Multi Res	2.38 people/unit

The Town of Gananoque's Public Works Utilities Division supplied hydrant flow data. Refer to the **Hydrant Flow Data Table** in **Appendix B** for hydrant details. Analysis has been completed to demonstrate that the proposed subdivision can be adequately serviced by the existing infrastructure.

Two fire hydrants, NFPA color-rated blue, are located in proximity to the existing subject. Hydrant number FH232 is located on Elmwood Drive in front of civic #130. FH252 is located at the intersection of John Street and William Street. Given the proximity of the hydrants and modelling junctions to the existing modeling area, the model flows of FH252 will be utilized for assessing the available fire flows.

Hydrant # FH252

Static Pressure: 469 kPa (68 psi)

Residual Pressure: 400 kPa (58 psi) @ 71 L/s / 4,260 L/min (1,126 USGPM)

Rated Flow: 165 L/s / 9,900 L/min (2,626 USGPM) @ 138 kPa (20 psi)

Appropriate demands were assigned to the existing and proposed distribution system and are summarized in the appendix. EPA NET (Version 2.0) was used to model the following: Peak Hour pressure demand (kPa), Maximum Daily pressure demand (kPa), (L/min) at Maximum Day plus Fire demand maintaining 140 kPa. Refer to **Appendix B, EPA NET** for modeling results and the proposed water infrastructure schematic.

Peak Hour

The proposed peak-hour demand for the subdivision is approximately 366 L/min (6.1 L/s) based on a peaking factor of 4.25. Maximum daily flow demand is approximately 234 L/min (3.9 L/s) based on a maximum day factor of 2.75. The proposed system maintains a minimum of 438 kPa, up to a maximum of 486 kPa at its critical point during peak hour flow conditions and 438 kPa during maximum day flow conditions. Refer to the **Distribution Demands, Peak Hour Flow, and Maximum Day Demand** modelling results in **Appendix B** for calculations and details.

Based on the modelling completed, under peak flow conditions and maximum day flow conditions exceed the minimum required pressure of 280 kPa and are below the maximum pressure of 700 kPa.

Proposed subdivision pressures are within the normal operation range of 280 kPa to 700 kPa.

Fire Flows

Water supply requirements for fire suppression in municipal water works systems are based on the "*Water Supply for Public Fire Protection, 2020*" by Fire Underwriters Survey (FUS).

Minimum requirements for water suppression are not less than 1,000 L/min for two hours or 2,000 L/min for one hour in addition to any domestic consumption at the maximum daily rate. Using the short method within the FUS guidelines, single and small two-family wood frame dwellings require a minimum of 4,000 L/min, where 3 meters of separation between exposures (1.5 m side yards) is provided.

According to the modelling, the maximum daily flow demand plus fire flow demand for the proposed subdivision is 6,000 L/min. The system was assessed at the minimum operating pressure of 140 kPa and the available maximum daily flow plus fire flow. Fire flows are adequate for the proposed single-detached residential dwellings.

200 mm diameter watermain and connections to the existing 300 mm diameter watermain extension on Elmwood Drive and Arthur Street, and the existing 150 mm diameter watermain on John Street are proposed. Fire hydrants are proposed at 150 m spacing throughout the subdivision.

The proposed subdivision meets the recommended minimum standards by FUS and the MECP requirements.

Based on the infrastructure review, there will be no negative impact on the local water distribution system. There is adequate water pressure and flow available for the proposed subdivision.

3. Conclusions

Preliminary design calculations find that the existing water infrastructure is capable of supplying adequate fire flow and pressure to the proposed subdivision.

Watermain connections to Elmwood Drive, John Street and Arthur Street are proposed.

50mm watermain looping is proposed within both cul-de-sacs to avoid stagnant dead-end sections.


The water network shall be designed in accordance with the Ministry of Environment, Conservation and Park Guidelines.

Approval by the Town of Gananoque's Public Works for the proposed watermain network is required. An application for watermain additions, modifications, replacements, and extensions for the watermain system will be required.

Appendix A

Concept Plan

FIG.2 – Proposed Water Infrastructure

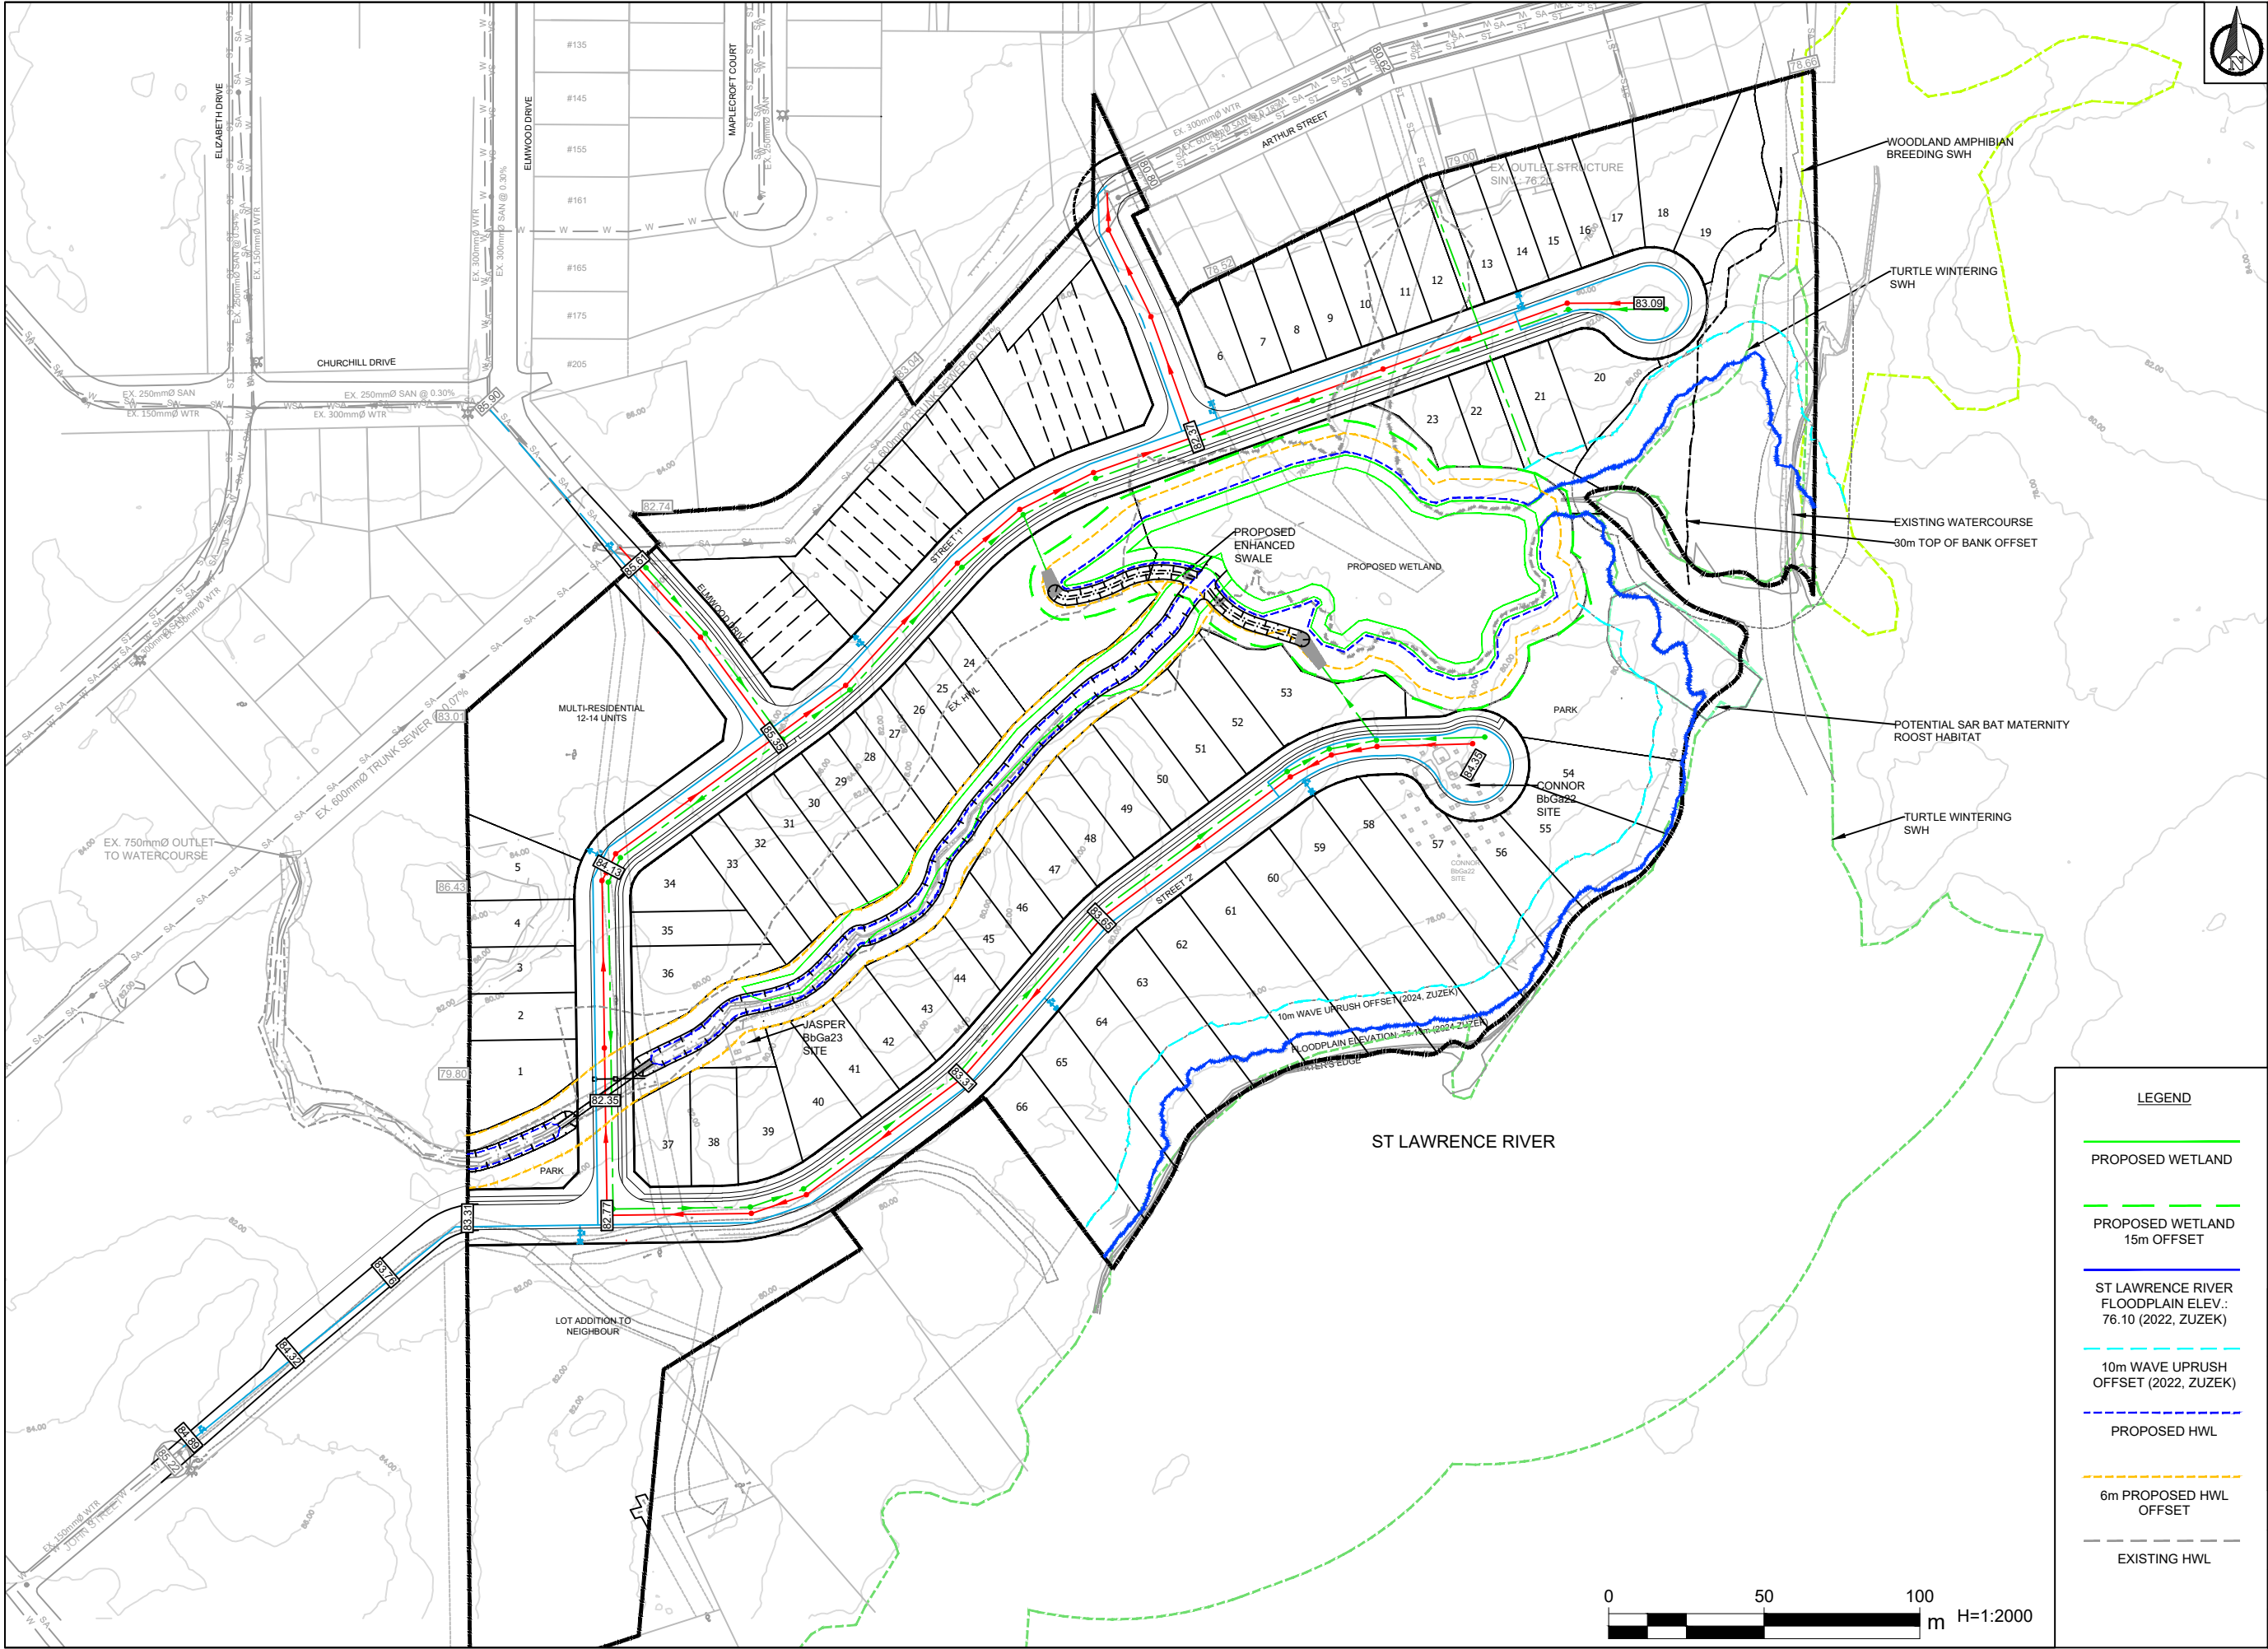

Benchmark		
No.	Revision/Issue	Date



1329 Gardiners Road, Suite 210
Kingston, ON, Canada K7P 0L8
613.634.9009 tel.
1.866.884.9392 fax.

Client

1000989284 ONTARIO INC.

Project

VL - ELMWOOD DRIVE

Drawing

CONCEPT PLAN

Drawn by:	Checked by:	Project No.
EP	JH	
Designed by:	Approved by:	Drawing No.
KMN	KMN	


Date: MAY 2026

Scale: 1:2000
ANSI B (11x17)

CP

- LEGEND
- PROPOSED WETLAND
 - PROPOSED WETLAND 15m OFFSET
 - ST LAWRENCE RIVER FLOODPLAIN ELEV.: 76.10 (2022, ZUZEK)
 - 10m WAVE UPRUSH OFFSET (2022, ZUZEK)
 - PROPOSED HWL
 - 6m PROPOSED HWL OFFSET
 - EXISTING HWL



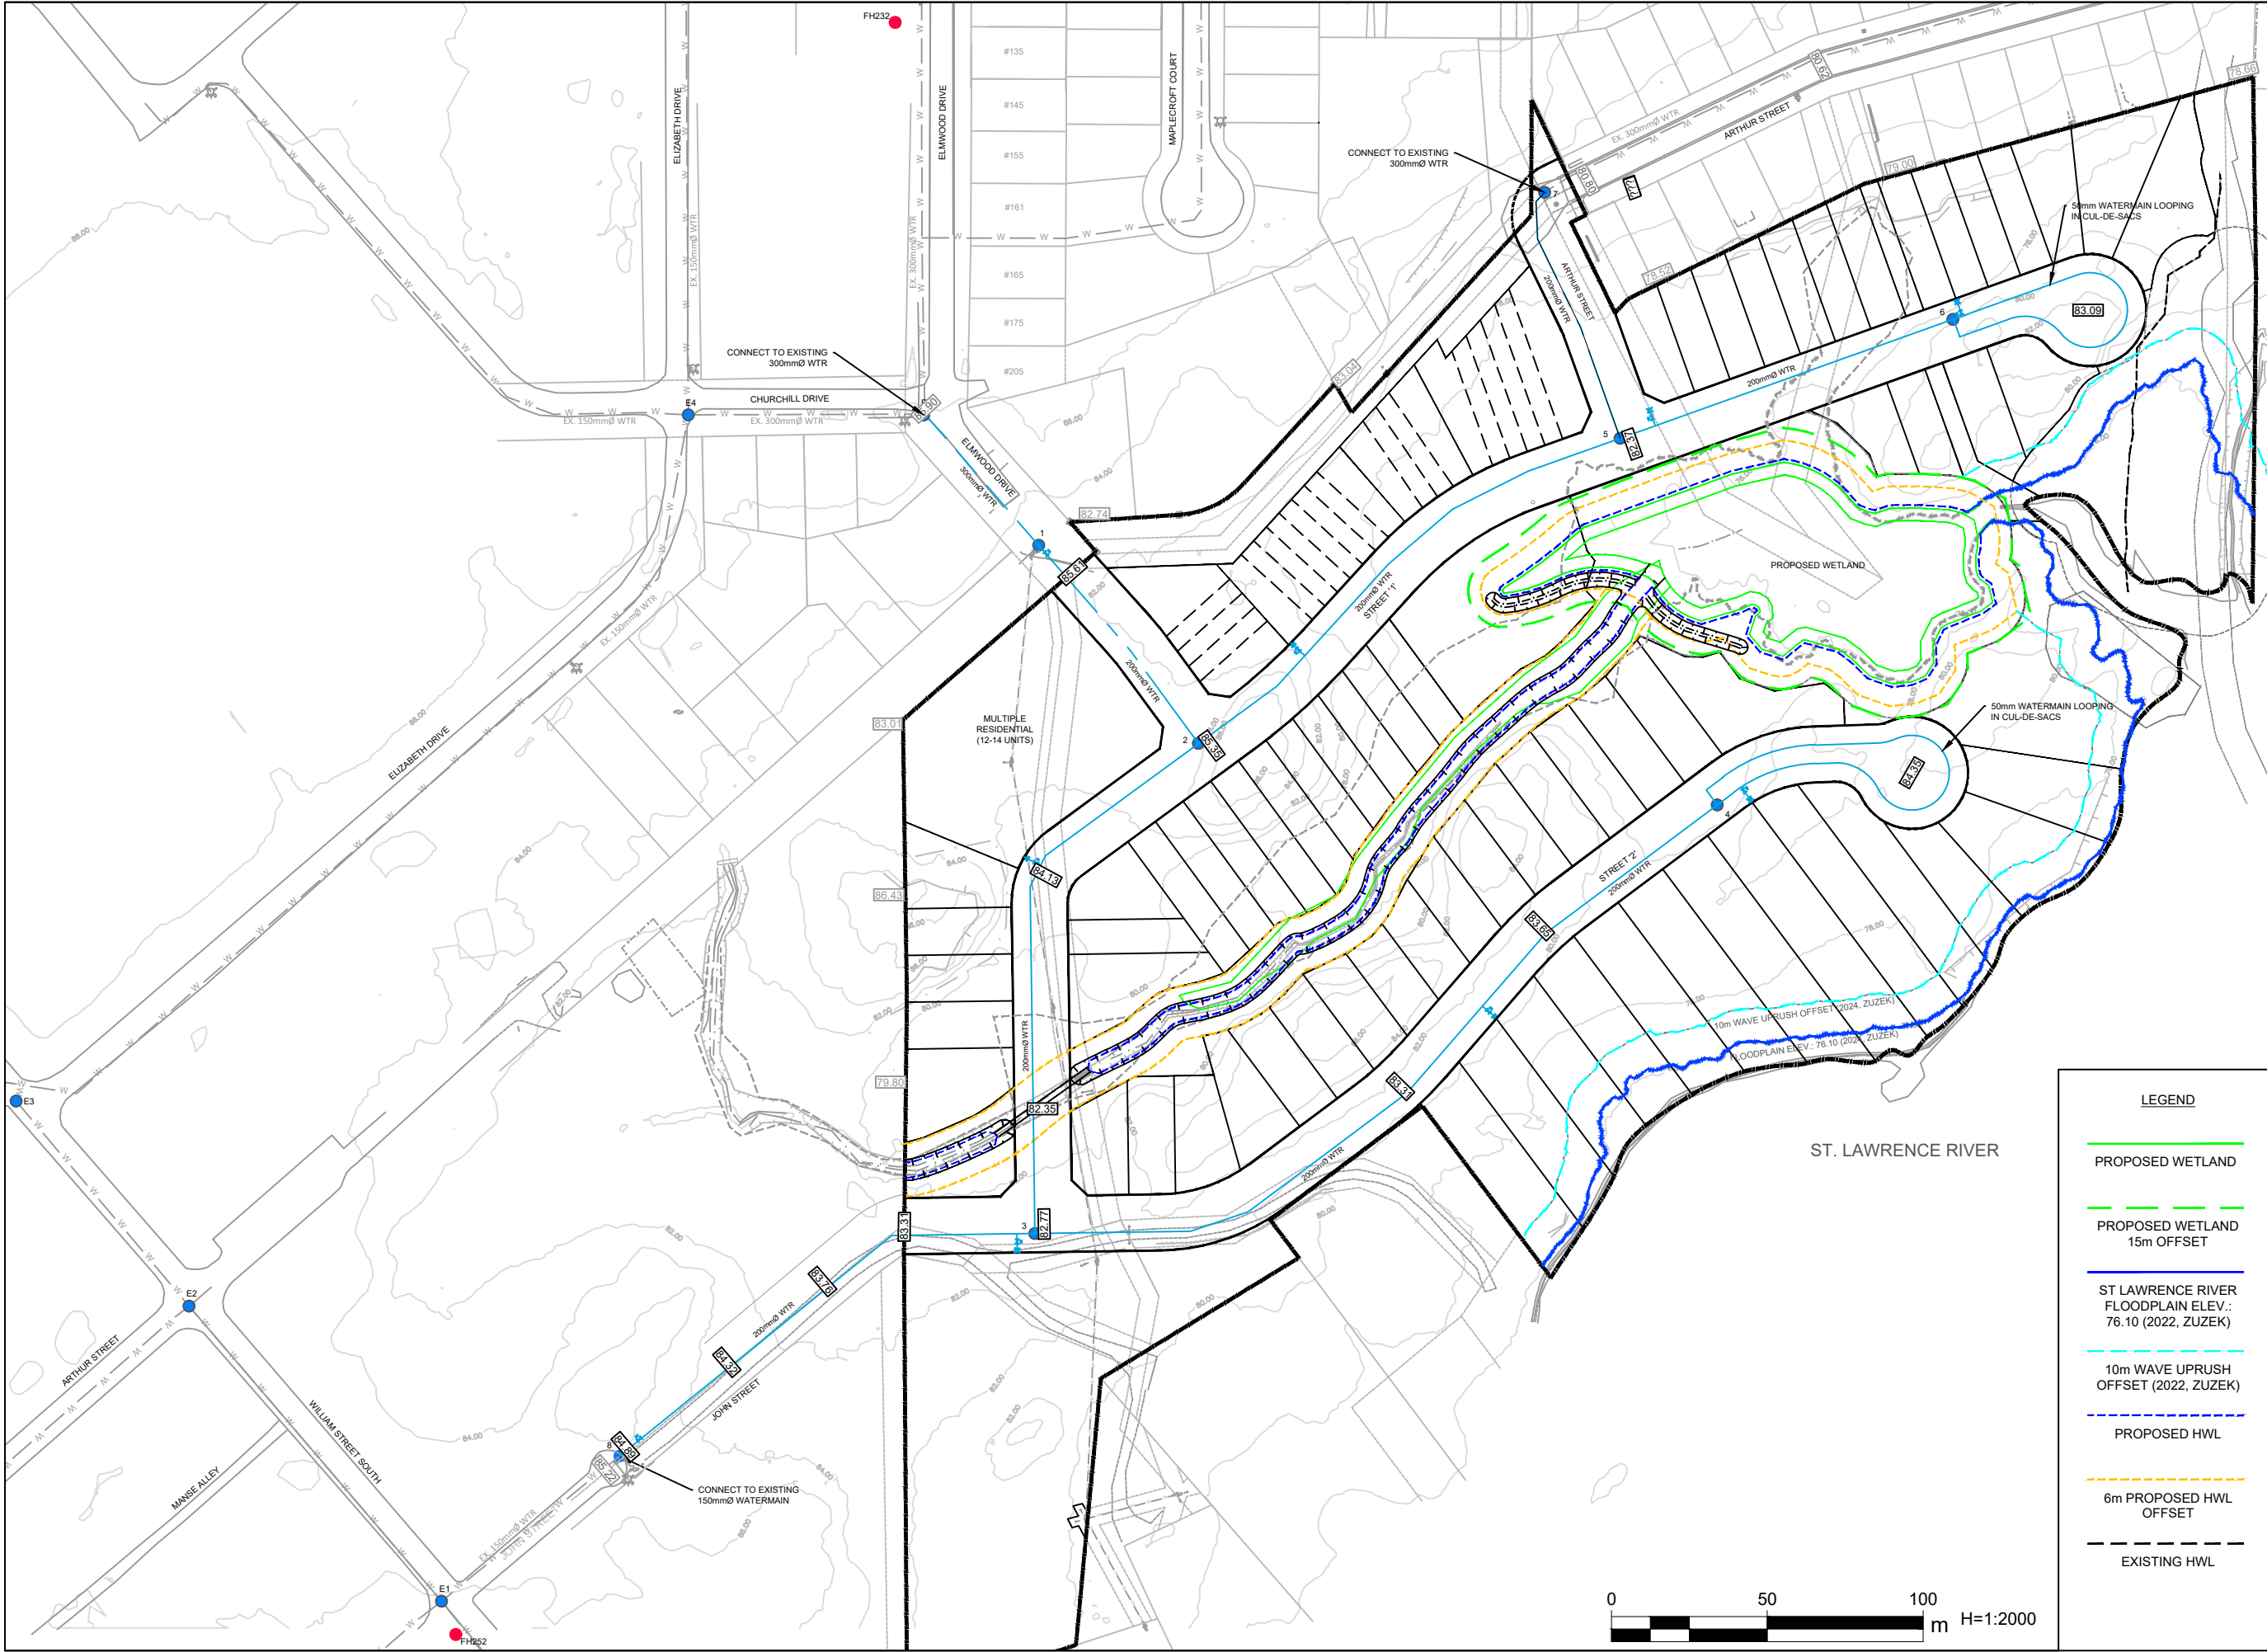

JUNCTION

PROPOSED WATERMAIN

EX. WATERMAIN



HYDRANT



WATERVALVE

Benchmark

No.	Revision/Issue	Date
-----	----------------	------

LEGEND

PROPOSED WETLAND

PROPOSED WETLAND
15m OFFSET

ST LAWRENCE RIVER
FLOODPLAIN ELEV.:
76.10 (2022, ZUZEK)

10m WAVE UPRUSH
OFFSET (2022, ZUZEK)

PROPOSED HWL

6m PROPOSED HWL
OFFSET

EXISTING HWL




1329 Gardiners Road, Suite 210
Kingston, ON, Canada K7P 0L8
613.634.9009 tel.
1.866.884.9392 fax.

Client
1000989284 ONTARIO INC.

Project
VL - ELMWOOD DRIVE

Drawing
PROPOSED WATER INFRASTRUCTURE

Drawn by: EP	Checked by: JH	Project No.
Designed by: KMN	Approved by: KMN	Drawing No.
Date: MAY 2026	FIG.2	
Scale: 1:2000 ANSI B (11x17)		



Appendix B

Hydrant Flow Data Table

Proposed Distribution Demands

EPA NET – Modelling Results

- Water Distribution Schematic
- Proposed Maximum Day Plus Fire Flow – Water Model Results
- Proposed Peak Hour Flow – Water Model Results

Gananoque Hydrant Flow Test Data Table

Flushing Order	Hydrant Number	Location	Year	Date of Work	Make	Port Size	Turbidity - NTU	Free Chlorine (mg/L)	Static PSI	Residual Pressure	Fire Flow (GPM)	New Colour	Pitot Pressure	Time Flushed	Flow GPM
96	FH206	102 John @ Stone	2018	05/24/18	McAvity		0.88	1.59	75	70	4543	Blue	55	10	1244
99	FH207	104 South St @ Stone	2018	05/25/18	Century	3.5 31A	2.01	+2.20	75	65	2826	Blue	45	10	1126
126	FH214	335 Elizabeth	2018	05/29/18	Century										
193	FH215	375 Elizabeth	2018	06/04/18	Century		1.19	+2.20	70	58	2145	Blue	35	10	993
194	FH216	185 Elizabeth @ Churchill	2018	06/03/18	Century	3.5 47A	2.47	2.19	65	24	636	Orange	13	25	605
202	FH217	115 Elizabeth	2018	06/26/18	Darling		2.31	2.01	67	22	384	Red	5	20	370
203	FH218	83 Elizabeth	2018	06/05/18	Century	3.5 31A	2.75	2.01	64	25	474	Red	7	10	444
122	FH222	156 Wellington	2018	05/29/18	Darling										
124	FH223	250 Wellington	2018	05/29/18	Century	3.5 31A	1.83	+2.20	70	52	1457	Green	25	15	839
195	FH231	250 Elmwood @ Churchill	2018	06/05/18	Darling		2.72	+2.20	72	57	1970	Blue	36	10	1007
196	FH232	130 Elmwood	2018	06/05/18	Darling		2.96	+2.20	69	56	2003	Blue	34	15	978
197	FH233	102 Elmwood	2018	06/05/18	Darling	3.5 31A	2.34	+2.20	72	58	2101	Blue	38	20	1034
214	FH236	115 Elmwood @ MacDonald	2018	06/06/18	Darling		2.72	+2.20	68	27	684	Orange	14	10	628
216	FH237	581 MacDonald	2018	06/06/18	Darling		2.8	2.04	66	23	389	Red	5	15	375
217	FH238	651 MacDonald	2018	06/06/18	Century		2.15	2.04	67	23	348	Red	4	15	336
218	FH239	697 MacDonald @ Conner	2018	06/06/18	Century		2.54	2.12	70	23	347	Red	4	15	336
103	FH252	299 John @ William S	2018	05/25/18	Century		0.81	+2.20	68	58	2626	Blue	45	10	1126
120	FH253	291 Arthur @ William S	2018	05/28/18	Century	5 47A	1.08	+2.20	70	50	1628	Blue	35	10	993
125	FH254	290 Wellington @ William S	2018	05/29/18	Darling		1.67	+2.20	70	52	1723	Blue	35	10	993
130	FH255	246 Sydenham	2018	05/29/18	Century		1.62	+2.20	71	25	251	Red	2	10	237
131	FH256	298 Sydenham @ William S	2018	05/29/18	Century	5 47A	1.16	+2.20	66	52	1966	Blue	38	10	1034
138	FH257	298 Pine @ William S	2018	05/29/18	Century		1.08	+2.20	68	54	2064	Blue	40	10	1061
104	FH260	335 John @ deadend	2018	05/25/18	Century	3.5 31A	0.57	+2.20	70	60	2001	Blue	25	10	839
105	FH301	King E by Susan Push	2018	05/25/18	Century	3.5 31A	1.49	+2.20	75	65	2492	Blue	35	15	993

DESIGN NOTES:

Single Family Res.	350 L/cap. D	(Leeds and the Thousand Islands Guideline)
- Single Family and Semi-detached	4 pop/unit	(Leeds and the Thousand Islands Guideline)
-Townhouse	2.38 pop/unit	(Leeds and the Thousand Islands Guideline)
-Multi- unit residential	2.38 pop/unit	(Leeds and the Thousand Islands Guideline)
Peak Hour Flow Factor	4.25	(MECP Water Guidelines Population <500)
Maximum Day Flow Factor	2.75	(MECP Water Guidelines Population <500)

Table 3-1: Peaking Factors



POPULATION	MINIMUM RATE FACTOR (MINIMUM HOUR)	MAXIMUM DAY FACTOR	PEAK RATE FACTOR (PEAK HOUR)
500 - 1 000	0.40	2.75	4.13
1 001 - 2 000	0.45	2.50	3.75
2 001 - 3 000	0.45	2.25	3.38
3 001 - 10 000	0.50	2.00	3.00
10 001 - 25 000	0.60	1.90	2.85
25 001 - 50 000	0.65	1.80	2.70
50 001 - 75 000	0.65	1.75	2.62
75 001 -150 000	0.70	1.65	2.48
greater than 150 000	0.80	1.50	2.25

Single Family Homes	Semi-Detached	Townhouse	Multi -Unit Residential	Street	Block	Nodes	Equivalent Population	Residential L/day	Population L/s	Peak Flow Demands	
										Peak Hour L/s	Maximum Day L/s
Elmwood Subdivision											
8		5	14	Street `1`		2	77.22	27,027.00	0.31	1.33	0.86
3				Street `1`		3	12.00	4,200.00	0.05	0.21	0.13
30				Street `2`		4	120.00	42,000.00	0.49	2.07	1.34
7		18		Street `1`		5	70.84	24,794.00	0.29	1.22	0.79
18				Street '1'		6	72.00	25,200.00	0.29	1.24	0.80
66	0	23	14	Total			352	123,221.00	1.43	6.06	3.92

TOTAL AVERAGE DAY FLOW	1.4 L/s
PEAK DAY FACTOR - 2.75	
MAXIMIUM DAY FLOW	3.9 L/s
PEAK HOUR FACTOR - 4.25	
PEAK HOUR FLOW	6.1 L/s

VL - Elmwood Water Distribution Network

Day 1, 12:00 A

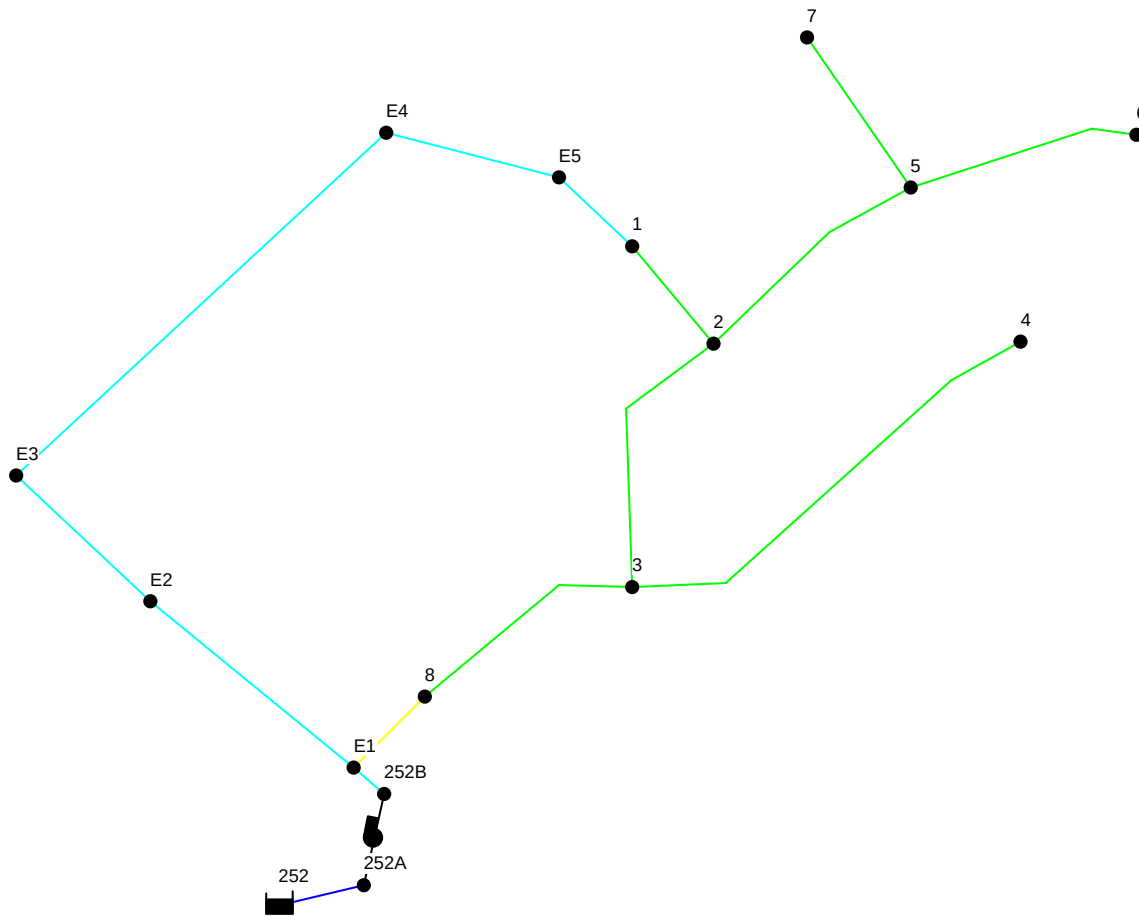

VL - Elmwood Development

Scenario: Proposed Network Maximum Day Demand

	MD Demand	Head	Pressure	Pressure	Pressure	Fire Flow	Fire Flow
Node ID	LPS	m	m	kPa	psi	lps	lpm
Junc 1	0.00	130.35	44.69	438	64	150	9000
Junc 2	0.860	130.34	44.99	441	64	140	8400
Junc 3	0.130	130.34	47.57	467	68	140	8400
Junc 4	1.340	130.34	46.17	453	66	100	6000
Junc 5	0.790	130.34	47.97	471	68	120	7200
Junc 6	0.800	130.34	47.54	466	68	100	6000
Junc 7	0.000	130.34	49.54	486	70	110	6600
Junc 8	0.000	130.35	45.46	446	65	140	8400
Junc E1	0.000	130.35	44.28	434	63	170	10200
Junc E2	0.000	130.35	45.35	445	65	170	10200
Junc E3	0.000	130.35	45.15	443	64	160	9600
Junc E4	0.000	130.35	43.55	427	62	150	9000
Junc E5	0.000	130.35	44.45	436	63	150	9000

VL - Elmwood Development

Scenario: Proposed Network Peak Demand

Node ID	PK Demand	Head	Pressure	Pressure	Pressure
	LPS	m	m	kPa	psi
Junc 1	0.00	130.31	44.65	438	64
Junc 2	1.330	130.30	44.95	441	64
Junc 3	0.210	130.30	47.53	466	68
Junc 4	2.070	130.28	46.11	452	66
Junc 5	1.220	130.29	47.92	470	68
Junc 6	1.240	130.28	47.48	466	68
Junc 7	0.000	130.29	49.49	485	70
Junc 8	0.000	130.31	45.42	446	65
Junc E1	0.000	130.33	44.25	434	63
Junc E2	0.000	130.33	45.33	445	64
Junc E3	0.000	130.33	45.13	443	64
Junc E4	0.000	130.32	43.52	427	62
Junc E5	0.000	130.32	44.42	436	63